



SONARtrac® Technical Bulletin

Subject: 4-20 mA Output Change

TB001


Priority: 4

Date: 27-Feb-04

Rev: 01

Software Version 01.05.10 and above changes scaling of the 4 – 20 mA output from 3 – 30 ft per sec to 0 – 30 ft per sec.

This change is represented graphically as follows:

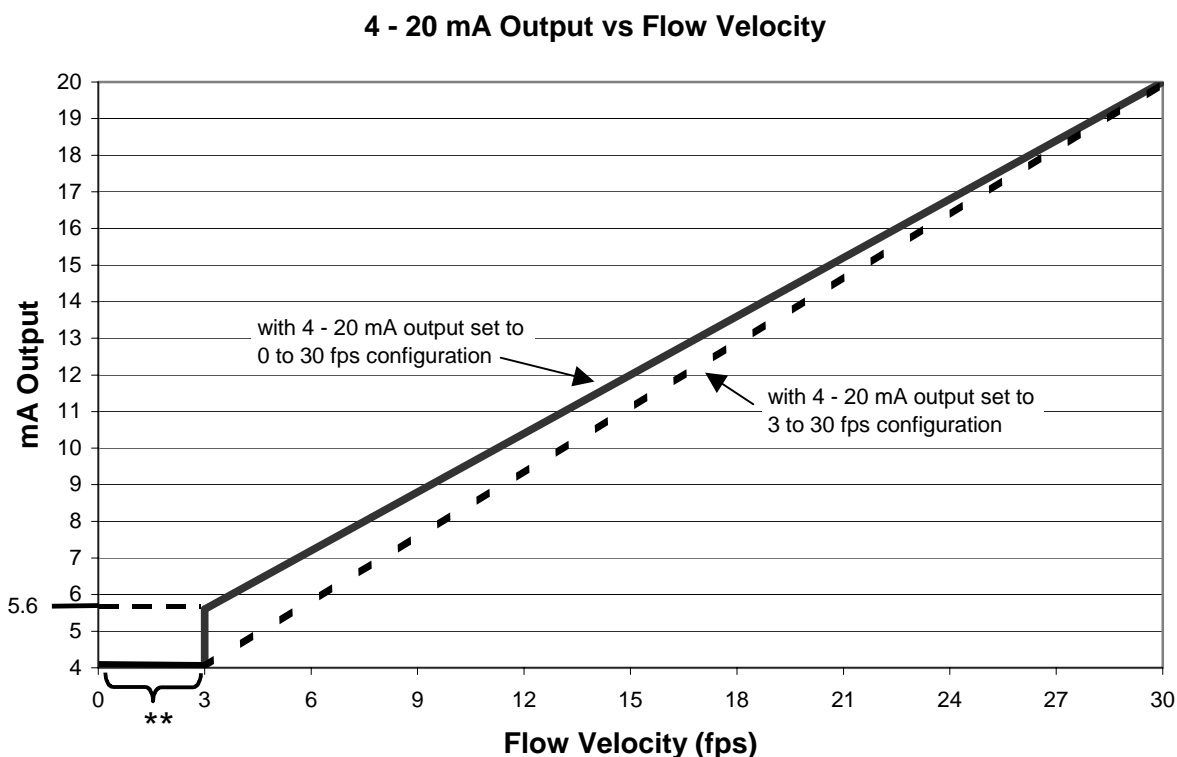

At the system Low Flow Cut Off of 3.0 fps, the value from the 4 – 20 mA output will be 5.6 mA.

**At flows less than 3.0 fps, greater than 30.0 fps, or if the meter is not working, the display will read as configured in the setup of the output (i.e. 'Hold' (at last value), <4 mA, 4 mA or >20 mA).


This change will be incorporated in the next manual revision.

Priority Code:			
1	Safety issue or system will not function	2	Intermittent problem causing system crash
3	Erratic data/readings	4	Added product feature
5	Product enhancement		

CiDRA Corporation
Tel. 203-265-0035

50 Barnes Park North
Fax. 203-294-4211

Wallingford, CT 06492
www.cidra.com

	SONARtrac® Technical Bulletin	
	Subject: 4-20 mA Output Change	TB001
		Priority: 4
		Date: 27-Feb-04
		Rev: 01

Document Change History

Date	Revision	Changed By	Description of Change
2/27/04	01	R. Markoja	Initial Release

Priority Code:			
1	Safety issue or system will not function	2	Intermittent problem causing system crash
3	Erratic data/readings	4	Added product feature
5	Product enhancement		

CiDRA Corporation
Tel. 203-265-0035

50 Barnes Park North
Fax. 203-294-4211

Wallingford, CT 06492
www.cidra.com